

Engineering Data

Capacity Table

REYA-AATJA, 208 / 230 V



REYA-AAYDA, 460 V

Heat Recovery 60 Hz

R-32



EMERSON

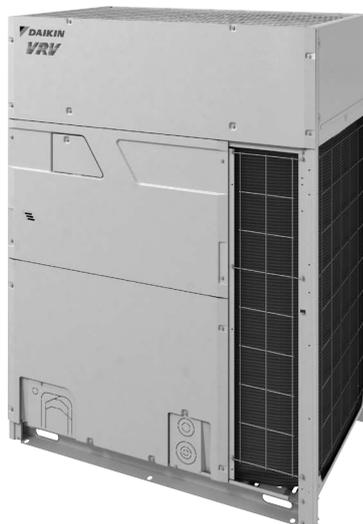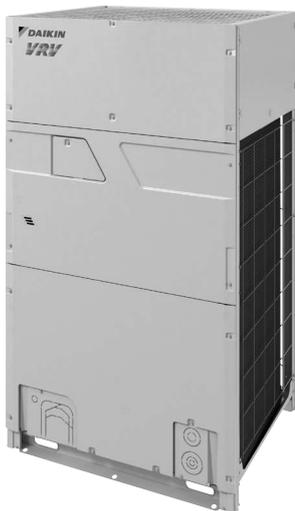

1. Capacity Tables (Reference Data) 4

- 1.1 Cooling Capacity for Standard Condition (Te: 43°F (6°C)) 4
 - 1.1.1 Fahrenheit 4
 - 1.1.2 Celsius..... 22
- 1.2 Heating Capacity for Standard Condition (Tc: 115°F (46°C)) 40
 - 1.2.1 Fahrenheit 40
 - 1.2.2 Celsius..... 58
- 1.3 Capacity Correction Factor 76
- 1.4 Notes for Heating Capacity Characteristics (Heat Recovery) 94

1. Capacity Tables (Reference Data)

1.1 Cooling Capacity for Standard Condition (Te: 43°F (6°C))

1.1.1 Fahrenheit

REYA72AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Combination	Outdoor air temp.	Indoor air temp. *FWB															
		57		61		64		67		70		72		75			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
%	*FDB	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW		
23	54.9	1.57	70.4	2.06	82.0	2.45	93.6	2.86	102	3.16	103	3.18	105	3.20			
30	54.9	1.61	70.4	2.13	82.0	2.54	93.6	2.97	99.4	3.20	101	3.22	103	3.24			
40	54.9	1.69	70.4	2.23	82.0	2.66	93.6	3.21	96.1	3.26	97.6	3.28	99.7	3.31			
50	54.9	1.77	70.4	2.35	82.0	2.86	90.7	3.29	92.9	3.32	94.3	3.34	96.5	3.37			
54	54.9	1.81	70.4	2.39	82.0	2.95	89.4	3.32	91.6	3.35	93.0	3.37	95.2	3.40			
58	54.9	1.84	70.4	2.42	82.0	3.05	88.1	3.34	90.3	3.37	91.7	3.39	93.9	3.42			
62	54.9	1.88	70.4	2.45	82.0	3.16	86.8	3.37	88.9	3.40	90.4	3.42	92.6	3.45			
66	54.9	1.92	70.4	2.51	82.0	3.27	85.5	3.39	87.6	3.42	89.1	3.45	91.3	3.48			
70	54.9	1.97	70.4	2.62	82.0	3.44	83.8	3.47	85.8	3.51	87.8	3.53	90.0	3.57			
72	54.9	2.01	70.4	2.65	81.4	3.53	83.5	3.57	85.7	3.60	87.1	3.62	89.3	3.66			
75	54.9	2.13	70.4	3.02	80.4	3.66	82.5	3.70	84.7	3.73	86.2	3.76	88.3	3.79			
79	54.9	2.29	70.4	3.26	79.1	3.84	81.2	3.81	83.4	3.91	84.9	3.94	87.0	3.98			
83	54.9	2.46	70.4	3.51	77.8	4.01	79.9	4.05	82.1	4.09	83.6	4.12	85.7	4.16			
87	54.9	2.64	70.4	3.77	76.5	4.19	78.6	4.23	80.8	4.28	82.3	4.31	84.1	4.34			
91	54.9	2.83	70.4	4.05	75.2	4.37	77.3	4.41	79.5	4.46	81.0	4.49	81.1	4.49			
93	54.9	2.92	70.4	4.20	74.5	4.45	76.7	4.50	78.9	4.55	79.5	4.56	79.5	4.56			
95	54.9	3.03	70.4	4.35	73.9	4.54	76.0	4.59	77.9	4.64	78.0	4.64	78.0	4.64			
99	54.9	3.25	70.4	4.67	72.6	4.72	74.7	4.77	74.9	4.78	74.9	4.78	74.9	4.78			
103	54.9	3.48	69.1	4.85	71.3	4.90	71.8	4.92	71.8	4.92	71.8	4.92	71.8	4.92			
106	54.9	3.66	68.1	4.98	69.5	5.02	69.5	5.02	69.5	5.02	69.5	5.02	69.5	5.02			
110	54.9	3.92	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16			
115	54.9	4.36	56.2	4.52	56.3	4.53	56.5	4.54	56.6	4.56	56.7	4.57	56.8	4.58			
118	49.0	3.94	49.1	3.96	49.3	3.97	49.4	3.99	49.5	4.00	49.6	4.01	49.7	4.03			
122	39.5	3.19	39.7	3.21	39.8	3.22	39.9	3.23	40.1	3.24	40.1	3.25	40.3	3.27			
23	50.7	1.44	65.0	1.98	75.7	2.24	86.4	2.61	97.1	2.99	101	3.16	103	3.18			
30	50.7	1.48	65.0	1.94	75.7	2.31	86.4	2.69	97.1	3.14	99.2	3.20	101	3.22			
40	50.7	1.55	65.0	2.04	75.7	2.43	86.4	2.85	94.6	3.24	95.9	3.26	97.9	3.28			
50	50.7	1.62	65.0	2.14	75.7	2.55	86.4	3.09	91.3	3.30	92.7	3.32	94.7	3.35			
54	50.7	1.66	65.0	2.18	75.7	2.63	86.4	3.19	90.0	3.33	91.4	3.35	93.4	3.37			
58	50.7	1.69	65.0	2.23	75.7	2.71	86.4	3.30	88.7	3.35	90.1	3.37	92.1	3.40			
62	50.7	1.72	65.0	2.28	75.7	2.80	85.4	3.35	87.4	3.38	88.6	3.40	90.6	3.43			
66	50.7	1.76	65.0	2.33	75.7	2.90	84.1	3.37	86.1	3.40	87.5	3.42	89.5	3.45			
70	50.7	1.80	65.0	2.45	75.7	3.05	82.8	3.46	84.8	3.49	86.2	3.51	88.2	3.54			
72	50.7	1.82	65.0	2.54	75.7	3.18	82.2	3.54	84.2	3.58	85.5	3.60	87.5	3.63			
75	50.7	1.91	65.0	2.69	75.7	3.36	81.2	3.68	83.2	3.71	84.5	3.73	86.5	3.76			
79	50.7	2.06	65.0	2.90	75.7	3.63	79.9	3.85	81.9	3.89	83.1	3.91	85.2	3.95			
83	50.7	2.21	65.0	3.12	75.7	3.91	78.6	4.03	80.6	4.07	81.9	4.09	83.9	4.13			
87	50.7	2.37	65.0	3.35	75.3	4.16	77.3	4.21	79.3	4.25	80.6	4.27	82.6	4.31			
91	50.7	2.53	65.0	3.60	74.4	4.34	76.0	4.38	78.0	4.42	79.3	4.44	81.4	4.49			
93	50.7	2.62	65.0	3.73	73.3	4.43	75.3	4.47	77.3	4.52	78.6	4.55	80.5	4.56			
95	50.7	2.71	65.0	3.86	72.7	4.52	74.7	4.56	76.7	4.61	78.0	4.64	78.0	4.64			
99	50.7	2.90	65.0	4.14	71.4	4.69	73.4	4.74	74.9	4.78	74.9	4.78	74.9	4.78			
103	50.7	3.11	65.0	4.44	70.1	4.87	71.8	4.92	71.8	4.92	71.8	4.92	71.8	4.92			
106	50.7	3.27	65.0	4.68	69.1	5.01	69.5	5.02	69.5	5.02	69.5	5.02	69.5	5.02			
110	50.7	3.50	65.0	5.03	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16			
115	50.7	3.89	55.0	4.22	56.3	4.53	56.5	4.54	56.6	4.56	56.7	4.57	56.8	4.58			
118	49.0	3.94	49.1	3.96	49.3	3.97	49.4	3.99	49.5	4.00	49.6	4.01	49.7	4.03			
122	39.5	3.19	39.7	3.21	39.8	3.22	39.9	3.23	40.1	3.24	40.1	3.25	40.3	3.27			
23	46.5	1.32	59.6	1.71	69.4	2.03	79.2	2.36	89.0	2.70	95.6	2.99	102	3.16			
30	46.5	1.35	59.6	1.76	69.4	2.09	79.2	2.44	89.0	2.79	95.6	3.07	99.4	3.20			
40	46.5	1.41	59.6	1.85	69.4	2.19	79.2	2.56	89.0	2.98	94.3	3.24	96.1	3.26			
50	46.5	1.48	59.6	1.94	69.4	2.31	79.2	2.72	89.0	3.23	91.3	3.30	92.9	3.32			
54	46.5	1.51	59.6	1.98	69.4	2.36	79.2	2.80	88.5	3.31	90.7	3.32	91.6	3.35			
58	46.5	1.54	59.6	2.02	69.4	2.44	79.2	2.88	87.8	3.33	89.4	3.35	90.3	3.37			
62	46.5	1.57	59.6	2.06	69.4	2.47	79.2	3.00	85.9	3.36	87.1	3.37	89.0	3.40			
66	46.5	1.60	59.6	2.11	69.4	2.56	79.2	3.10	84.6	3.38	85.8	3.40	87.7	3.43			
70	46.5	1.63	59.6	2.17	69.4	2.69	79.2	3.27	83.3	3.47	84.5	3.48	86.4	3.51			
72	46.5	1.65	59.6	2.25	69.4	2.79	79.2	3.40	82.7	3.55	83.9	3.57	85.7	3.60			
75	46.5	1.71	59.6	2.38	69.4	2.96	79.2	3.60	81.7	3.68	82.9	3.70	84.8	3.74			
79	46.5	1.84	59.6	2.56	69.4	3.19	78.6	3.83	80.4	3.86	81.6	3.88	83.5	3.91			
83	46.5	1.97	59.6	2.80	69.4	3.43	77.3	4.04	79.0	4.07	80.3	4.09	82.6	4.13			
87	46.5	2.11	59.6	2.96	69.4	3.69	75.5	4.18	77.8	4.22	79.0	4.24	80.2	4.28			
91	46.5	2.26	59.6	3.17	69.4	3.96	74.6	4.35	76.5	4.39	77.7	4.42	79.5	4.46			
93	46.5	2.33	59.6	3.29	69.4	4.11	74.0	4.44	75.8	4.48	77.1	4.51	78.9	4.55			
95	46.5	2.41	59.6	3.40	69.4	4.26	73.3	4.53	75.2	4.57	76.0	4.60	78.0	4.64			
99	46.5	2.58	59.6	3.65	69.4	4.57	72.0	4.71	73.9	4.75	74.9	4.78	74.9	4.78			
103	46.5	2.76	59.6	3.91	68.9	4.84	70.7	4.89	71.8	4.92	71.8	4.92	71.8	4.92			
106	46.5	2.90	59.6	4.11	67.9	4.97	69.5	5.02	69.5	5.02	69.5	5.02	69.5	5.02			
110	46.5	3.10	59.6	4.42	65.0	5.16	66.4	5.16	66.4	5.16	66.4	5.16	66.4	5.16			
115	46.5	3.44	56.2	4.52	56.3	4.53	56.5	4.54	56.6	4.56	56.7	4.57	56.8	4.58			
118	46.5	3.66	49.1	3.96	49.3	3.97	49.4	3.99	49.5	4.00	49.6	4.01	49.7	4.03			
122	39.5	3.19	39.7	3.21	39.8	3.22	39.9	3.23	40.1	3.24	40.1	3.25	40.3	3.27			
23	42.2	1.20	54.1	1.54	63.1	1.82	72.0	2.11	80.9	2.42	86.9	2.62	95.8	2.94			
30	42.2	1.23	54.1	1.59	63.1	1.88	72.0	2.18	80.9	2.50	86.9	2.71	95.8	3.08			
40	42.2	1.28	54.1	1.66	63.1	1.97	72.0	2.29	80.9	2.62	86.9	2.87	94.3	3.24			
50	42.2	1.34	54.1	1.74	63.1												

REYA96AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100) and outdoor air temperature (23, 30, 40, 50, 54, 58, 62, 66, 70, 75, 79, 83, 87, 91, 95, 99, 103, 106, 110, 115, 118, 122).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50) and outdoor air temperature (23, 30, 40, 50, 54, 58, 62, 66, 70, 75, 79, 83, 87, 91, 95, 99, 103, 106, 110, 115, 118, 122).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA120AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA144AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and values for % and °FDB. Rows are grouped by capacity (130, 120, 110, 100, 90).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and values for % and °FDB. Rows are grouped by capacity (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA168AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and cooling capacity values (MBH, kW) for various indoor air temperatures (57, 61, 64, 67, 70, 72, 75) and outdoor air temperatures (23 to 122).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and cooling capacity values (MBH, kW) for various indoor air temperatures (57, 61, 64, 67, 70, 72, 75) and outdoor air temperatures (23 to 122).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA192AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and values for % and °FDB. Rows are grouped by indoor air temperature (130, 120, 110, 100, 90).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), and values for % and °FDB. Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA216AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and performance metrics (FDB, MBH, kW) for various indoor air temperatures and outdoor air temperatures.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and performance metrics (FDB, MBH, kW) for various indoor air temperatures and outdoor air temperatures.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA240AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (FDB, MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (FDB, MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA264AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA288AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB, 57, 61, 64, 67, 70, 72, 75. Rows include combinations 130, 120, 110, 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB, 57, 61, 64, 67, 70, 72, 75. Rows include combinations 80, 70, 60, 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA312AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA336AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and Capacity (MBH, kW). Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA360AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and % FDB. Rows are grouped by indoor air temperature (130, 120, 110, 100, 90) and outdoor air temperature (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 95, 99, 103, 106, 110, 115, 118, 122).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and % FDB. Rows are grouped by indoor air temperature (80, 70, 60, 50) and outdoor air temperature (23, 30, 40, 50, 54, 58, 62, 66, 70, 72, 75, 79, 83, 87, 91, 95, 99, 103, 106, 110, 115, 118, 122).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA384AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and capacity values (MBH, kW) for various conditions (57, 61, 64, 67, 70, 72, 75).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and capacity values (MBH, kW) for various conditions (57, 61, 64, 67, 70, 72, 75).

- TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included. And actual results may vary according to conditions of use.

REYA408AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75). Rows include percentages and various indoor/outdoor temperature combinations.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75). Rows include percentages and various indoor/outdoor temperature combinations.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA432AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), % FDB, MBH, kW. Rows include combinations 130, 120, 110, 100, and 90.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °F/WB (57, 61, 64, 67, 70, 72, 75), % FDB, MBH, kW. Rows include combinations 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA456AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and performance metrics (% FDB, MBH, kW) for various indoor/outdoor temperature pairs.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F WB (57, 61, 64, 67, 70, 72, 75), and performance metrics (% FDB, MBH, kW) for various indoor/outdoor temperature pairs.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA480AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 43°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and performance metrics (FDB, MBH, kW) for indoor air temps 57, 61, 64, 67, 70, 72, 75.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °F/WB, and performance metrics (FDB, MBH, kW) for indoor air temps 57, 61, 64, 67, 70, 72, 75.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included. And actual results may vary according to conditions of use.

1.1.2 Celsius REYA72AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW/kW. Rows are categorized by indoor air temperature (130, 120, 110, 100) and outdoor air temperature (-5.0 to 50.0).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW/kW. Rows are categorized by indoor air temperature (80, 70, 60, 50) and outdoor air temperature (-5.0 to 50.0).

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ... is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA96AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and % CDB. Rows are grouped by capacity (130, 120, 110, 100) and include sub-headers for TC and PI.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and % CDB. Rows are grouped by capacity (80, 70, 60, 50) and include sub-headers for TC and PI.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA120AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA144AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and Capacity (kW, PI). Includes sub-sections for 130, 120, 110, and 100. Includes footnotes for TC, PI, and Note 1-3.

REYA168AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB, and Cooling Capacity (kW). It is divided into three main sections for indoor air temperatures of 13.9, 16.1, 17.8, 19.4, 21.1, 22.2, and 23.9 °CWB. Each section contains a grid of data for different combinations of indoor air temperatures and fan speeds (CDB, PI).

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. This table reflects performance of the outdoor unit only. And not an entire system.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA192AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, 100, 80, and 50. Includes a legend for TC and PI, and a note about performance and conditions.

REYA216AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and %.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and %.

- TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA240AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA264AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9 to 23.9), and % values. Rows are grouped by indoor air temperature (130, 120, 110, 100).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9 to 23.9), and % values. Rows are grouped by indoor air temperature (80, 70, 60, 50).

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA288AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 90.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA312AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Combination	Outdoor air temp.	Indoor air temp. °CWB															
		13.9		16.1		17.8		19.4		21.1		22.2		23.9			
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI		
%	°CDB	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
130	-5.0	69.3	8.92	88.8	11.7	103	14.0	118	16.3	128	18.0	130	18.1	133	18.2		
	-1.1	69.3	9.20	88.8	12.1	103	14.4	118	16.9	125	18.2	127	18.3	130	18.5		
	4.4	69.3	9.63	88.8	12.7	103	15.2	118	18.3	121	18.6	123	18.7	126	18.8		
	10.0	69.3	10.1	88.8	13.4	103	16.3	114	18.8	117	18.9	119	19.0	122	19.2		
	12.2	69.3	10.3	88.8	13.6	103	16.8	113	18.9	116	19.1	117	19.2	120	19.4		
	14.4	69.3	10.5	88.8	13.9	103	17.4	111	19.1	114	19.2	116	19.3	118	19.5		
	16.7	69.3	10.7	88.8	14.4	103	18.0	109	19.2	112	19.4	114	19.5	117	19.7		
	18.9	69.3	11.0	88.8	14.9	103	18.6	108	19.3	111	19.5	112	19.6	115	19.8		
	21.1	69.3	11.2	88.8	15.6	103	19.6	106	19.8	109	20.0	111	20.1	114	20.3		
	22.2	69.3	11.5	88.8	16.3	103	20.1	105	20.3	108	20.5	110	20.6	113	20.8		
	23.9	69.3	12.1	88.8	17.2	101	20.9	104	21.1	107	21.3	109	21.4	111	21.6		
	26.1	69.3	13.0	88.8	18.6	99.8	21.9	103	22.1	105	22.3	107	22.5	110	22.7		
	28.3	69.3	14.0	88.8	20.0	98.1	22.9	101	23.1	104	23.3	105	23.5	108	23.7		
	30.6	69.3	15.0	88.8	21.5	96.5	23.9	99.2	24.1	102	24.4	104	24.5	107	24.8		
	32.8	69.3	16.1	88.8	23.1	94.9	24.9	97.6	25.1	100	25.4	102	25.6	104	25.7		
	33.9	69.3	16.7	88.8	23.9	94.0	25.4	96.6	25.1	99.5	25.2	101	25.3	104	24.4		
	35.0	69.3	17.3	88.8	24.8	93.2	25.9	96.0	25.2	98.7	25.5	99.5	25.5	99.5	25.5		
	37.2	69.3	18.5	88.8	26.6	91.6	26.9	94.3	27.2	95.5	27.3	95.5	27.3	95.5	27.3		
	39.4	69.3	19.8	87.2	27.6	89.9	27.9	91.4	28.1	91.4	28.1	91.4	28.1	91.5	28.1		
	41.1	69.3	21.1	86.0	28.8	88.4	29.1	88.4	29.1	88.4	29.1	88.4	29.1	88.5	29.1		
43.3	69.3	23.0	84.3	30.4	84.4	30.4	84.4	30.4	84.4	30.4	84.4	30.4	84.4	30.4			
46.1	69.3	25.6	72.9	27.6	73.0	27.7	73.2	27.8	73.3	27.8	73.4	27.9	73.6	28.0			
47.8	63.1	23.9	63.3	24.0	63.5	24.1	63.6	24.1	63.8	24.2	63.9	24.3	64.0	24.4			
50.0	60.4	19.0	50.6	19.1	50.8	19.2	50.9	19.2	51.1	19.3	51.2	19.4	51.3	19.4			
120	-5.0	64.0	8.20	82.0	10.7	95.5	12.8	109	14.9	123	17.0	128	18.0	131	18.1		
	-1.1	64.0	8.45	82.0	11.1	95.5	13.2	109	15.4	123	17.9	125	18.2	128	18.4		
	4.4	64.0	8.83	82.0	11.6	95.5	13.8	109	16.2	119	18.5	121	18.6	124	18.7		
	10.0	64.0	9.25	82.0	12.2	95.5	14.5	109	17.6	115	18.8	117	18.9	119	19.1		
	12.2	64.0	9.43	82.0	12.4	95.5	15.0	109	18.2	114	19.0	115	19.1	118	19.2		
	14.4	64.0	9.62	82.0	12.7	95.5	15.5	109	18.8	112	19.1	114	19.2	116	19.4		
	16.7	64.0	9.92	82.0	13.0	95.5	16.0	108	19.1	110	19.2	112	19.4	115	19.5		
	18.9	64.0	10.0	82.0	13.3	95.5	16.5	106	19.2	109	19.4	110	19.5	113	19.7		
	21.1	64.0	10.2	82.0	14.0	95.5	17.4	105	19.7	107	19.9	109	20.0	111	20.2		
	22.2	64.0	10.4	82.0	14.5	95.5	18.1	104	20.2	106	20.4	108	20.5	110	20.7		
	23.9	64.0	10.9	82.0	15.3	95.5	19.2	102	20.9	105	21.1	107	21.3	109	21.5		
	26.1	64.0	11.7	82.0	16.5	95.5	20.7	101	21.9	103	22.2	105	22.3	108	22.5		
	28.3	64.0	12.6	82.0	17.8	95.5	22.3	99.2	23.0	102	23.2	103	23.3	106	23.5		
	30.6	64.0	13.5	82.0	19.1	95.5	23.7	97.5	24.0	100	24.2	102	24.3	104	24.6		
	32.8	64.0	14.4	82.0	20.5	93.4	24.7	95.9	25.0	98.4	25.2	100	25.4	103	25.6		
	33.9	64.0	14.9	82.0	21.2	92.5	25.2	95.1	25.5	97.6	25.7	99.3	25.9	102	26.1		
	35.0	64.0	15.5	82.0	22.0	91.7	25.7	94.3	26.0	96.8	26.3	98.5	26.4	99.5	26.5		
	37.2	64.0	16.5	82.0	23.6	90.1	26.7	92.6	27.0	95.1	27.3	95.5	27.3	95.5	27.3		
	39.4	64.0	17.7	82.0	25.3	88.4	27.8	91.0	28.1	91.4	28.1	91.4	28.1	91.5	28.1		
	41.1	64.0	18.9	82.0	27.0	87.2	28.9	88.4	29.1	88.4	29.1	88.4	29.1	88.5	29.1		
43.3	64.0	20.6	82.0	29.5	84.3	30.4	84.4	30.4	84.4	30.4	84.4	30.4	84.4	30.4			
46.1	64.0	22.9	72.9	27.6	73.0	27.7	73.2	27.8	73.3	27.8	73.4	27.9	73.6	28.0			
47.8	63.1	23.9	63.3	24.0	63.5	24.1	63.6	24.1	63.8	24.2	63.9	24.3	64.0	24.4			
50.0	60.4	19.0	50.6	19.1	50.8	19.2	50.9	19.2	51.1	19.3	51.2	19.4	51.3	19.4			
110	-5.0	58.6	7.50	75.2	9.74	87.5	11.6	99.9	13.4	112	15.4	121	16.7	128	18.0		
	-1.1	58.6	7.72	75.2	10.1	87.5	11.9	99.9	13.9	112	15.9	121	17.5	125	18.2		
	4.4	58.6	8.05	75.2	10.5	87.5	12.5	99.9	14.6	112	17.0	119	18.5	121	18.6		
	10.0	58.6	8.43	75.2	11.1	87.5	13.1	99.9	15.5	112	18.4	115	18.8	117	18.9		
	12.2	58.6	8.59	75.2	11.3	87.5	13.4	99.9	16.0	112	18.8	115	18.9	116	19.1		
	14.4	58.6	8.76	75.2	11.5	87.5	13.7	99.9	16.5	112	19.0	112	19.1	114	19.2		
	16.7	58.6	8.94	75.2	11.8	87.5	14.1	99.9	17.1	108	19.1	110	19.2	112	19.4		
	18.9	58.6	9.12	75.2	12.0	87.5	14.6	99.9	17.7	107	19.3	108	19.4	111	19.5		
	21.1	58.6	9.31	75.2	12.4	87.5	15.3	99.9	18.6	105	19.7	107	19.9	109	20.0		
	22.2	58.6	9.41	75.2	12.8	87.5	15.9	99.9	19.4	104	20.2	106	20.4	108	20.5		
	23.9	58.6	9.74	75.2	13.6	87.5	16.9	99.9	20.5	103	21.0	105	21.1	107	21.3		
	26.1	58.6	10.5	75.2	14.6	87.5	18.2	99.1	21.8	101	22.0	103	22.1	105	22.3		
	28.3	58.6	11.4	75.2	15.9	87.5	19.9	98.5	23.8	99.5	24.0	102	23.3	105	23.5		
	30.6	58.6	12.0	75.2	16.8	87.5	21.0	95.5	23.8	98.2	24.0	99.7	24.2	102	24.4		
	32.8	58.6	12.9	75.2	18.1	87.5	22.6	94.2	24.8	96.5	25.0	98.1	25.2	100	25.4		
	33.9	58.6	13.3	75.2	18.7	87.5	23.4	93.4	25.3	95.7	25.5	97.2	25.7	99.6	25.9		
	35.0	58.6	13.8	75.2	19.4	87.5	24.3	92.6	25.8	94.9	26.1	96.4	26.2	98.7	26.5		
	37.2	58.6	14.7	75.2	20.8	87.5	26.0	90.9	26.8	93.2	27.1	94.8	27.3	95.5	27.3		
	39.4	58.6	15.7	75.2	22.3	86.9	27.6	89.3	27.9	91.4	28.1	91.4	28.1	91.5	28.1		
	41.1	58.6	16.7	75.2	23.8	85.7	28.7	88.0	28.9	88.4	29.1	88.4	29.1	88.5	29.1		
43.3	58.6	18.2	75.2	25.9	84.4	30.4	84.4	30.4	84.4	30.4	84.4	30.4	84.4	30.4			
46.1	58.6	20.2	72.9	27.6	73.0	27.7	73.2	27.8	73.3	27.8	73.4	27.9	73.6	28.0			
47.8	58.6	21.5	63.3	24.0	63.5	24.1	63.6	24.1	63.8	24.2	63.9	24.3	64.0	24.4			
50.0	60.4	19.0	50.6	19.1	50.8	19.2	50.9	19.2	5								

REYA336AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and %.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and %.

- TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA384AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 90.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

- TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA408AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA432AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB, and various capacity values (kW, PI) for different indoor air conditions. Includes sub-sections for 130, 120, 110, and 90. Includes a legend for TC and PI, and a note about performance and other factors.

REYA456AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB, and Capacity (kW). It is divided into sections for indoor air temperatures of 13.9, 16.1, 17.8, 19.4, 21.1, 22.2, and 23.9 °CWB. Each section contains a grid of data for different combinations of fan motor and compressor types.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA480AATJA / AAYDA Cooling Capacity for Standard Condition (Te: 6°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CWB (13.9, 16.1, 17.8, 19.4, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. ■ is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

1.2 Heating Capacity for Standard Condition (Tc: 115°F (46°C))

1.2.1 Fahrenheit

REYA72AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Combination	Outdoor air temp.		Indoor air temp. °FDB																																									
			61			65			68			70			72			75																										
			TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH	TC	PI	MBH																								
%	*FDB	*FWB	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW	MBH	kW																								
130	-21.8	-22.0	37.1	2.02	36.9	3.41	36.7	3.44	36.6	4.17	36.5	4.38	36.4	6.09	36.2	4.92	-17.1	-17.5	41.6	4.08	41.4	4.48	41.2	4.77	41.1	4.97	41.0	5.17	40.9	5.46														
	-17.1	-17.5	41.8	3.64	41.6	4.07	41.4	4.39	41.3	4.60	41.2	4.81	41.1	5.14	-12.6	-13.0	46.6	4.25	46.4	4.65	46.2	4.94	46.1	5.14	46.0	5.33	45.9	5.58	45.8	5.63														
	-9.0	-9.4	51.6	4.68	51.4	5.06	51.2	5.33	51.1	5.52	51.0	5.71	50.8	5.98	-3.64	-4.0	59.6	5.26	59.4	5.60	59.2	5.86	59.1	6.03	59.0	6.20	58.9	6.46	-1.84	-2.2	61.8	5.44	61.6	5.77	61.4	6.02	61.2	6.19	61.1	6.36	60.9	6.61		
	5.5	5.0	70.7	6.08	70.5	6.39	70.3	6.62	70.2	6.77	70.0	6.92	69.9	7.15	9.5	8.5	75.2	6.37	75.0	6.66	74.8	6.88	74.6	7.03	74.5	7.17	74.3	7.39	13.0	12.0	79.8	6.64	79.5	6.92	79.3	7.13	79.2	7.27	79.1	7.41	78.9	7.63		
	15.0	14.0	82.4	6.78	82.2	7.06	82.0	7.27	81.8	7.41	81.7	7.55	81.5	7.75	17.0	15.5	84.0	6.86	83.7	7.13	83.5	7.33	83.4	7.47	83.3	7.61	83.1	7.81	19.0	18.0	86.6	6.98	86.4	7.24	86.2	7.44	86.1	7.57	85.9	7.70	85.7	7.90		
	22.0	20.0	88.7	7.06	88.5	7.32	88.3	7.51	88.2	7.64	88.0	7.77	87.8	7.96	26.0	24.0	93.0	7.23	92.7	7.47	92.5	7.66	92.4	7.78	92.3	7.90	92.1	8.08	30.0	28.0	97.2	7.38	96.9	7.61	96.7	7.79	96.6	7.90	96.5	8.02	96.4	8.12	96.3	8.24
	35.0	32.0	101	7.52	101	7.74	101	7.91	101	8.02	101	8.12	101	8.24	39.0	36.0	106	7.64	106	7.86	106	8.02	106	8.13	106	8.25	106	8.37	44.0	40.0	110	7.76	110	7.97	109	8.12	109	8.25	109	8.33	109	8.41		
	44.0	40.0	110	7.76	110	7.97	109	8.12	109	8.25	109	8.33	109	8.41	47.0	43.0	113	7.84	113	8.04	110	7.89	105	7.46	101	7.04	93.5	6.43	51.0	47.0	117	7.94	117	8.14	110	7.52	105	7.12	101	7.02	93.5	6.43		
	54.0	50.0	120	8.01	117	7.86	110	7.27	105	6.88	101	6.20	93.5	5.94	57.0	53.0	124	8.08	117	7.60	110	7.03	105	6.65	101	6.29	93.5	5.75	60.0	56.0	126	8.12	117	7.36	110	6.80	105	6.44	101	6.09	93.5	5.58		
	60.0	56.0	126	8.12	117	7.36	110	6.80	105	6.44	101	6.09	93.5	5.58	9.5	8.5	74.9	6.67	74.7	6.94	74.5	7.15	74.4	7.28	74.3	7.42	74.1	7.62	13.0	12.0	79.5	6.93	79.3	7.13	79.2	7.27	79.1	7.41	78.9	7.63				
	15.0	14.0	82.1	7.07	81.9	7.33	81.7	7.52	81.6	7.65	81.5	7.77	81.3	7.97	17.0	15.5	83.7	7.14	83.5	7.39	83.3	7.58	83.2	7.70	83.1	7.83	82.9	8.02	22.0	20.0	86.5	7.25	86.1	7.49	85.9	7.67	85.8	7.79	85.7	7.92	85.5	8.10		
	22.0	20.0	86.5	7.25	86.1	7.49	85.9	7.67	85.8	7.79	85.7	7.92	85.5	8.10	26.0	24.0	92.7	7.48	92.5	7.71	92.3	7.88	92.2	7.99	92.0	8.10	91.8	8.24	30.0	28.0	96.9	7.62	96.7	7.84	96.5	8.00	96.4	8.11	92.9	7.75	86.4	7.07		
35.0	32.0	101	7.75	101	7.95	101	8.11	97.2	7.77	92.9	7.33	86.4	6.69	39.0	36.0	105	7.86	105	8.06	102	7.79	97.2	7.36	92.9	6.95	86.4	6.35	44.0	40.0	110	7.97	108	8.01	102	7.39	97.2	7.00	92.9	6.61	86.4	6.04			
44.0	40.0	110	7.97	108	8.01	102	7.39	97.2	7.00	92.9	6.61	86.4	6.04	47.0	43.0	113	8.05	108	7.71	102	7.13	97.2	6.75	92.9	6.37	86.4	5.83	51.0	47.0	117	8.12	108	7.35	102	6.80	97.2	6.44	92.9	6.09	86.4	5.57			
54.0	50.0	117	7.84	108	7.10	102	6.57	97.2	6.23	92.9	5.89	86.4	5.39	57.0	53.0	117	7.57	108	6.87	102	6.36	97.2	6.03	92.9	5.70	86.4	5.23	60.0	56.0	117	7.33	108	6.65	102	6.16	97.2	5.84	92.9	5.53	86.4	5.07			
60.0	56.0	117	7.33	108	6.65	102	6.16	97.2	5.84	92.9	5.53	86.4	5.07	-21.8	-22.0	36.7	3.89	36.5	4.29	36.4	4.59	36.3	4.79	36.2	4.98	36.1	5.28	-17.1	-17.5	41.4	4.52	41.2	4.89	41.0	5.16	40.9	5.34	40.9	5.52	40.7	5.79			
-12.6	-13.0	46.2	5.07	46.0	5.40	45.8	5.65	45.7	5.82	45.6	5.98	45.5	6.23	-9.0	-9.4	51.2	5.45	51.0	5.77	50.8	6.00	50.7	6.16	50.6	6.32	50.5	6.55	-3.64	-4.0	59.1	5.97	58.9	6.26	58.8	6.48	58.7	6.62	58.6	6.77	58.5	6.98			
-1.84	-2.2	61.3	6.13	61.1	6.41	60.9	6.62	60.8	6.77	60.7	6.91	60.6	7.12	5.5	5.0	70.2	6.71	70.0	6.97	69.8	7.17	69.7	7.30	69.6	7.43	69.5	7.62	13.0	12.0	79.7	7.07	79.5	7.22	79.3	7.43	79.2	7.53	79.1	7.66	78.9	7.84			
15.0	14.0	81.9	7.36	81.7	7.56	81.5	7.77	81.4	7.89	81.3	8.00	79.2	7.86	17.0	15.5	83.5	7.42	83.2	7.65	83.1	7.82	83.0	7.94	82.9	8.05	79.2	7.66	19.0	18.0	86.1	7.52	85.9	7.74	85.7	7.91	85.6	8.02	85.5	8.07	85.4	8.12			
22.0	20.0	88.2	7.60	88.0	7.81	87.8	7.98	87.7	8.08	85.1	7.82	79.2	7.13	26.0	24.0	92.4	7.73	92.2	7.94	92.0	8.10	89.1	7.79	85.1	7.35	79.2	6.71	30.0	28.0	96.6	7.86	96.4	8.06	96.3	8.17	96.2	8.28	96.1	8.39	96.0	8.50			
35.0	32.0	101	7.98	99.0	7.96	93.1	7.35	89.1	6.96	85.1	6.57	79.2	6.04	39.0	36.0	105	8.09	99.0	7.54	93.1	6.97	89.1	6.60	85.1	6.24	79.2	5.71	44.0	40.0	110	7.91	99.0	7.17	93.1	6.63	89.1	6.28	85.1	5.90	79.2	5.44			
47.0	43.0	107	7.62	99.0	6.91	93.1	6.39	89.1	6.06	85.1	5.73	79.2	5.25	51.0	47.0	107	7.26	99.0	6.59	93.1	6.09	89.1	5.79	85.1	5.48	79.2	5.02	54.0	50.0	107	7.02	99.0	6.37	93.1	5.90	89.1	5.60	85.1	5.30	79.2	4.87			
57.0	53.0	107	6.79	99.0	6.17	93.1	5.72	89.1	5.42	85.1	5.14	79.2	4.72	60.0	56.0	107	6.57	99.0	5.97	93.1	5.54	89.1	5.26	85.1	4.98	79.2	4.58	-21.8	-22.0	36.5	4.38	36.3	4.74	36.2	5.01	36.1	5.19	36.0	5.37					
-17.1	-17.5	41.1	4.07	41.0	4.29	40.9	4.54	40.8	4.71	40.7	4.87	40.6	5.12	-12.6	-13.0	45.9	4.47	45.7	4.78	45.6	5.00	45.5	5.16	45.4	5.33	45.3	5.53	-9.0	-9.4	50.9	5.84	50.7	6.12	50.6	6.34	50.5	6.48	50.4	6.62	50.3	6.84			
-3.64	-4.0	58.9	6.32	58.7	6.59	58.5	6.79	58.4	6.92	58.3	7.05	58.2	7.25	-1.84	-2.2	61.0	6.48	60.9	6.73	60.7	6.93	60.6	7.05	60.5	7.18	60.4	7.38	5.5	5.0	70.0	7.03	69.8	7.27	69.6	7.44	69.5	7.56	69.4	7.68	69.3	7.85			
9.5	8.5	74.4	7.28	74.2	7.50	74.1	7.67	74.0	7.79	73.9	7.90	73.8	8.02	13.0	12.0	79.0	7.51	78.8	7.73	78.6	7.90	78.5	8.00	77.4	7.90	72.0	7.20	15.0	14.0	81.6	7.64	81.4	7.86	81.3	8.02	81.0	8.10	77.4	7.64	72.0	6.96			
17.0	15.5	83.2	7.70	83.0	7.91	82.8	8.07	81.0	7.89	77.4	7.45	72.0	6.79	19.0	18.0	85.8	7.79	85.6	7.99	84.6	8.01	81.0	7.58	77.4	7.15	72.0	6.53	22.0	20.0	87.9	7.86	87.7	8.06	84.6	7.76	81.0	7.34	77.4	6.93	72.0	6.33			
26.0	24.0	92.2	7.99	90.0	7.90	84.6	7.30	81.0	6.91	77.4	6.52	72.0	5.97	30.0	28.0	96.4	8.10	90.0	7.45	84.6	6.89	81.0	6.52	77.4	6.17	72.0	5.64	35.0	32.0	97.3	7.78	90.0	7.05	84.6	6.52	81.0	6.18	77.4	5.80	72.0	5.35			
39.0	36.0	97.3	7.37	90.0	6.69	84.6</																																						

REYA96AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include outdoor air temperatures from -21.8 to 60.0 and indoor air temperatures from 61 to 75.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include outdoor air temperatures from -21.8 to 60.0 and indoor air temperatures from 61 to 75.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA120AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and capacity values (MBH, kW) for various indoor air temperatures.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and capacity values (MBH, kW) for various indoor air temperatures.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA144AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include % values and various temperature combinations for indoor air temperatures 61, 65, 68, 70, 72, and 75.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include % values and various temperature combinations for indoor air temperatures 61, 65, 68, 70, 72, and 75.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA168AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include outdoor air temperatures from -21.8 to 60.0 and indoor air temperatures from 61 to 75.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include outdoor air temperatures from -21.8 to 60.0 and indoor air temperatures from 61 to 75.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA192AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW) for various indoor/outdoor temperature pairs.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW) for various indoor/outdoor temperature pairs.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [Symbol] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included. And actual results may vary according to conditions of use.

REYA216AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are categorized by indoor air temperature (130, 120, 110, 100, 90) and outdoor air temperature (-21.8 to 60.0).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are categorized by indoor air temperature (80, 70, 60, 50) and outdoor air temperature (-21.8 to 60.0).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA240AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW) for TC and PI. Includes sub-sections for 130, 120, 110, 100, and 90.

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW) for TC and PI. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA264AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 130, 120, 110, 100, and 90.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA288AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and MBH/kW values. Rows are grouped by capacity (130, 120, 110, 100, 90).

Table with columns for Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and MBH/kW values. Rows are grouped by capacity (80, 70, 60, 50).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA312AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are grouped by model (130, 120, 110, 100, 90) and outdoor air temperature.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are grouped by model (80, 70, 60, 50) and outdoor air temperature.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA336AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are grouped by model (130, 120, 110, 100, 90) and outdoor air temperature.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows are grouped by model (80, 70, 60, 50) and outdoor air temperature.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA360AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 130, 120, 110, 100, and 90.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA384AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and performance metrics (% FDB, FWB, MBH, kW).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and performance metrics (% FDB, FWB, MBH, kW).

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA408AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include % values and specific temperature points for combinations 130, 120, 110, 100, and 90.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include % values and specific temperature points for combinations 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA432AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 130, 120, 110, 100, and 90.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and Heating Capacity (MBH, kW). Rows include combinations 80, 70, 60, and 50.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA456AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and heating capacity values (MBH, kW) for various conditions.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and heating capacity values (MBH, kW) for various conditions.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [Symbol] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA480AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 115°F)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and heating capacity values (MBH, kW) for various indoor/outdoor temperature combinations.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °FDB (61, 65, 68, 70, 72, 75), and heating capacity values (MBH, kW) for various indoor/outdoor temperature combinations.

TC: Total capacity: MBH
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

1.2.2 Celsius
REYA72AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA96AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity; kW
PI: Power input; kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA120AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA144AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), % (TC, PI, kW, kW). Rows include combinations 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), % (TC, PI, kW, kW). Rows include combinations 80, 70, 60, and 50.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA168AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns for Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, 100, and 90. Includes a note at the bottom: 'Note: 1. This table reflects performance of the outdoor unit only. And not an entire system. 3. Other factors such as indoor unit power consumption, piping losses, etc. are not included. And actual results may vary according to conditions of use.'

REYA192AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA216AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA240AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included. And actual results may vary according to conditions of use.

REYA264AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW/kW. Rows are grouped by model (130, 120, 110, 100, 90) and outdoor air temperature.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW/kW. Rows are grouped by model (80, 70, 60, 50) and outdoor air temperature.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA288AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI. Includes sub-sections for 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values for TC and PI. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity; kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA312AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Rows are grouped by model number (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Rows are grouped by model number (80, 70, 60, 50).

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA336AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA360AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA384AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW. Rows are grouped by model (130, 120, 110, 100, 90) and outdoor air temperature.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW. Rows are grouped by model (80, 70, 60, 50) and outdoor air temperature.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. [shaded] is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA408AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Includes sub-sections for 80, 70, 60, and 50.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA432AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp. (°CDB, °CWB), Indoor air temp. (°CDB) for 16.1, 18.3, 20.0, 21.1, 22.2, 23.9. Rows include capacity and power input for various combinations.

Table with columns: Combination, Outdoor air temp. (°CDB, °CWB), Indoor air temp. (°CDB) for 16.1, 18.3, 20.0, 21.1, 22.2, 23.9. Rows include capacity and power input for various combinations.

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA456AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp. (°CDB, °CWB), Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Rows are grouped by model (130, 120, 110, 100, 90).

Table with columns: Combination, Outdoor air temp. (°CDB, °CWB), Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW values. Rows are grouped by model (80, 70, 60, 50).

TC: Total capacity: kW
PI: Power input: kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

REYA480AATJA / AAYDA Heating Capacity for Standard Condition (Tc: 46°C)

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW/kW. Rows include combinations 130, 120, 110, and 100.

Table with columns: Combination, Outdoor air temp., Indoor air temp. °CDB (16.1, 18.3, 20.0, 21.1, 22.2, 23.9), and kW/kW. Rows include combinations 80, 70, 60, and 50.

TC: Total capacity; kW
PI: Power input; kW (Compressor+Outdoor fan motor)
Note: 1. is shown as reference.
2. This table reflects performance of the outdoor unit only. And not an entire system.
3. Other factors such as indoor unit power consumption, piping losses, etc. are not included.
And actual results may vary according to conditions of use.

1.3 Capacity Correction Factor

REYA72AATJA / AAYDA

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																		
	25	66	98	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623
Indoor Lower than Outdoor	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81
FL ±	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Indoor Higher than Outdoor	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)													
	25	66	98	131	164	197	230	262	295	328	361	394	427	460
Indoor Lower than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
FL ±	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Indoor Higher than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA72AA1JA	φ 1/2
REYA72AA2DA	

- In the case where the equivalent piping length from outdoor units to indoor units ≥ 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA72AA1JA	φ 5/8
REYA72AA2DA	


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA72AA1JA	φ 3/8
REYA72AA2DA	

- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA72AA1JA	0.2
REYA72AA2DA	

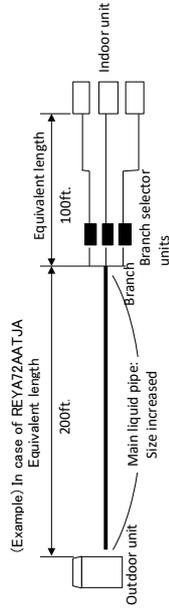

- Overall equivalent length = 200ft. X 0.2 + 100 ft. = 140 ft.
- Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

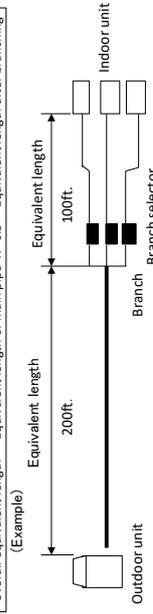

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.91.

[Notes] 1. Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.

2. Under partial load conditions, capacity factor becomes smaller than them.

3. Method of calculating A/C (cooling/heating) capacity : The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

- When indoor units combination ratio does not exceed 100% :

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \times$$

- When indoor units combination ratio exceeds 100% :

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \times$$

REYA96AATJA / AAYDA

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA96AATJA	φ 1/2
REYA96AAYDA	φ 1/2

- In the case where the equivalent piping length from outdoor units to indoor units 2295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1): >164 ft. (50 m) (if outdoor unit is lower than indoor unit >130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe, referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA96AATJA	φ 5/8
REYA96AAYDA	φ 5/8



[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA96AATJA	φ 3/8
REYA96AAYDA	φ 3/8

- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA96AATJA	0.2
REYA96AAYDA	0.2

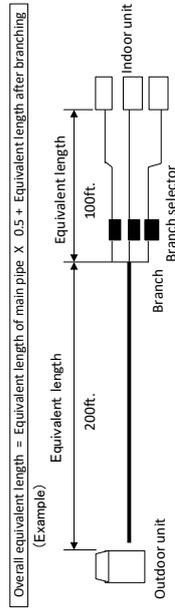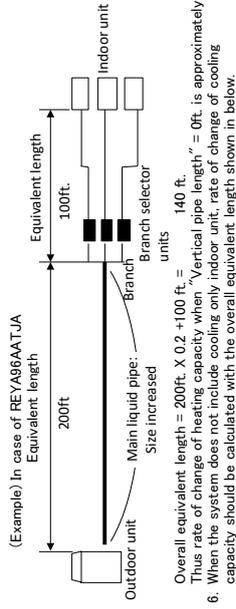

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																		
	25	66	98	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	625
Indoor Lower than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
FL±	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																		
	25	66	98	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	625
Indoor Lower than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
FL±	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

- [Notes]
- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions. Under partial load conditions, capacity change becomes smaller than them.
 - With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
 - Method of calculating A/C (cooling/heating) capacity : The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$$

$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$$

- When indoor units combination ratio exceeds 100% :

REYA120AATJA / AAYDA

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
	25	66	98	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656	689	722	755	788	821	854	887	920	953	986	1019	1052	1085	1118	1151	1184	1217	1250	1283	1316	1349	1382	1415	1448	1481	1514	1547	1580	1613	1646	1679	1712	1745	1778	1811	1844	1877	1910	1943	1976	2009	2042	2075	2108	2141	2174	2207	2240	2273	2306	2339	2372	2405	2438	2471	2504	2537	2570	2603	2636	2669	2702	2735	2768	2801	2834	2867	2900	2933	2966	2999	3032	3065	3098	3131	3164	3197	3230	3263	3296	3329	3362	3395	3428	3461	3494	3527	3560	3593	3626	3659	3692	3725	3758	3791	3824	3857	3890	3923	3956	3989	4022	4055	4088	4121	4154	4187	4220	4253	4286	4319	4352	4385	4418	4451	4484	4517	4550	4583	4616	4649	4682	4715	4748	4781	4814	4847	4880	4913	4946	4979	5012	5045	5078	5111	5144	5177	5210	5243	5276	5309	5342	5375	5408	5441	5474	5507	5540	5573	5606	5639	5672	5705	5738	5771	5804	5837	5870	5903	5936	5969	6002	6035	6068	6101	6134	6167	6200	6233	6266	6299	6332	6365	6398	6431	6464	6497	6530	6563	6596	6629	6662	6695	6728	6761	6794	6827	6860	6893	6926	6959	6992	7025	7058	7091	7124	7157	7190	7223	7256	7289	7322	7355	7388	7421	7454	7487	7520	7553	7586	7619	7652	7685	7718	7751	7784	7817	7850	7883	7916	7949	7982	8015	8048	8081	8114	8147	8180	8213	8246	8279	8312	8345	8378	8411	8444	8477	8510	8543	8576	8609	8642	8675	8708	8741	8774	8807	8840	8873	8906	8939	8972	9005	9038	9071	9104	9137	9170	9203	9236	9269	9302	9335	9368	9401	9434	9467	9500	9533	9566	9599	9632	9665	9698	9731	9764	9797	9830	9863	9896	9929	9962	9995	10028	10061	10094	10127	10160	10193	10226	10259	10292	10325	10358	10391	10424	10457	10490	10523	10556	10589	10622	10655	10688	10721	10754	10787	10820	10853	10886	10919	10952	10985	11018	11051	11084	11117	11150	11183	11216	11249	11282	11315	11348	11381	11414	11447	11480	11513	11546	11579	11612	11645	11678	11711	11744	11777	11810	11843	11876	11909	11942	11975	12008	12041	12074	12107	12140	12173	12206	12239	12272	12305	12338	12371	12404	12437	12470	12503	12536	12569	12602	12635	12668	12701	12734	12767	12800	12833	12866	12899	12932	12965	12998	13031	13064	13097	13130	13163	13196	13229	13262	13295	13328	13361	13394	13427	13460	13493	13526	13559	13592	13625	13658	13691	13724	13757	13790	13823	13856	13889	13922	13955	13988	14021	14054	14087	14120	14153	14186	14219	14252	14285	14318	14351	14384	14417	14450	14483	14516	14549	14582	14615	14648	14681	14714	14747	14780	14813	14846	14879	14912	14945	14978	15011	15044	15077	15110	15143	15176	15209	15242	15275	15308	15341	15374	15407	15440	15473	15506	15539	15572	15605	15638	15671	15704	15737	15770	15803	15836	15869	15902	15935	15968	16001	16034	16067	16100	16133	16166	16199	16232	16265	16298	16331	16364	16397	16430	16463	16496	16529	16562	16595	16628	16661	16694	16727	16760	16793	16826	16859	16892	16925	16958	16991	17024	17057	17090	17123	17156	17189	17222	17255	17288	17321	17354	17387	17420	17453	17486	17519	17552	17585	17618	17651	17684	17717	17750	17783	17816	17849	17882	17915	17948	17981	18014	18047	18080	18113	18146	18179	18212	18245	18278	18311	18344	18377	18410	18443	18476	18509	18542	18575	18608	18641	18674	18707	18740	18773	18806	18839	18872	18905	18938	18971	19004	19037	19070	19103	19136	19169	19202	19235	19268	19301	19334	19367	19400	19433	19466	19499	19532	19565	19598	19631	19664	19697	19730	19763	19796	19829	19862	19895	19928	19961	19994	20027	20060	20093	20126	20159	20192	20225	20258	20291	20324	20357	20390	20423	20456	20489	20522	20555	20588	20621	20654	20687	20720	20753	20786	20819	20852	20885	20918	20951	20984	21017	21050	21083	21116	21149	21182	21215	21248	21281	21314	21347	21380	21413	21446	21479	21512	21545	21578	21611	21644	21677	21710	21743	21776	21809	21842	21875	21908	21941	21974	22007	22040	22073	22106	22139	22172	22205	22238	22271	22304	22337	22370	22403	22436	22469	22502	22535	22568	22601	22634	22667	22700	22733	22766	22799	22832	22865	22898	22931	22964	22997	23030	23063	23096	23129	23162	23195	23228	23261	23294	23327	23360	23393	23426	23459	23492	23525	23558	23591	23624	23657	23690	23723	23756	23789	23822	23855	23888	23921	23954	23987	24020	24053	24086	24119	24152	24185	24218	24251	24284	24317	24350	24383	24416	24449	24482	24515	24548	24581	24614	24647	24680	24713	24746	24779	24812	24845	24878	24911	24944	24977	25010	25043	25076	25109	25142	25175	25208	25241	25274	25307	25340	25373	25406	25439	25472	25505	25538	25571	25604	25637	25670	25703	25736	25769	25802	25835	25868	25901	25934	25967	26000	26033	26066	26099	26132	26165	26198	26231	26264	26297	26330	26363	26396	26429	26462	26495	26528	26561	26594	26627	26660	26693	26726	26759	26792	26825	26858	26891	26924	26957	26990	27023	27056	27089	27122	27155	27188	27221	27254	27287	27320	27353	27386	27419	27452	27485	27518	27551	27584	27617	27650	27683	27716	27749	27782	27815	27848	27881	27914	27947	27980	28013	28046	28079	28112	28145	28178	28211	28244	28277	28310	28343	28376	28409	28442	28475	28508	28541	28574	28607	28640	28673	28706	28739	28772	28805	28838	28871	28904	28937	28970	29003	29036	29069	29102	29135	29168	29201	29234	29267	29300	29333	29366	29399	29432	29465	29498	29531	29564	29597	29630	29663	29696	29729	29762	29795	29828	29861	29894	29927	29960	29993	30026	30059	30092	30125	30158	30191	30224	30257	30290	30323	30356	30389	30422	30455	30488	30521	30554	30587	30620	30653	30686	30719	30752	30785	30818	30851	30884	30917	30950	30983	31016	31049	31082	31115	31148	31181	31214	31247	31280	31313	31346	31379	31412	31445	31478	31511	31544	31577	31610	31643	31676	31709	31742	31775	31808	31841	31874	31907	31940	31973	32006	32039	32072	32105	32138	32171	32204	32237	32270	32303	32336	32369	32402	32435	32468	32501	32534	32567	32600	32633	32666	32699	32732	32765	32798	32831	32864	32897	32930	32963	32996	33029	33062	33095	33128	33161	33194	33227	33260	33293	33326	33359	33392	33425	33458	33491	33524	33557	33590	33623	33656	33689	33722	33755	33788	33821	33854	33887	33920	33953	33986	34019	34052	34085	34118	34151	34184	34217	34250	34283	34316	34349	34382	34415	34448	34481	34514	34547	34580	34613	34646	34679	34712	34745	34778	34811	34844	34877	34910	34943	34976	35009	35042	35075	35108	35141	35174	35207	35240	35273	35306	35339	35372	35405	35438	35471	35504	35537	35570	35603	35636	35669	35702	35735	35768	35801	35834	35867	35900	35933	35966	36000	36033	36066	36099	36132	36165	36198	36231	36264	36297	36330	36363	36396	36429	36462	36495	36528	36561	36594	36627	36660	36693	36726	36759	36792	36825	36858	36891	36924	36957	36990	37023	37056	37089	37122	37155	37188	37221	37254	37287	37320	37353	37386	37419	37452	37485	37518	37551	37584	37617	37650	37683	37716	37749	37782	37815	37848	37881	37914	37947	37980	38013	38046	38079	38112	38145	38178	38211	38244	38277	38310	38343	38376	38409	38442	38475	38508	38541	38574	38607	38640	38673	38706	38739	38772	38805	38838	38871	38904	38937	38970	39003	39036	39069	39102	39135	39168	39201	39234	39267	39300	39333	39366	39399	39432	39465	39498	39531	39564	39597	39630	39663	39696	39729	39762	39795	39828	39861	39894	39927	39960	39993	40026	40059	40092	40125	40158	40191	40224	40257	40290	40323	40356	40389	40422	40455	40488	40521	40554	40587	40620	40653	40686	40719	40752	40785	40818	40851	40884	40917	40950	40983	41016	41049

REYA144AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA144AATJA REYA144AAYDA	φ 5/8

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).



Model	Liquid pipe
REYA144AATJA REYA144AAYDA	φ 3/4

[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA144AATJA REYA144AAYDA	φ 1/2

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Model	Correction factor
REYA144AATJA REYA144AAYDA	0.4

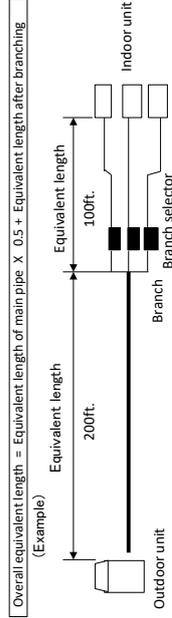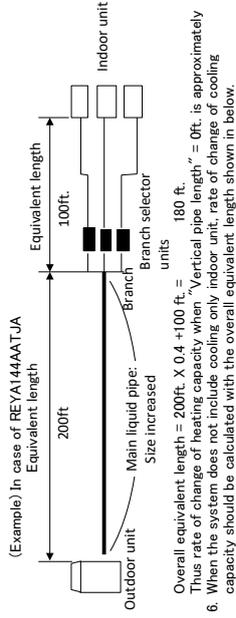

- 6. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96
Indoor Higher than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96
Indoor Higher than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- With this outdoor unit, evaporating pressure becomes constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
When indoor units combination ratio does not exceed 100% :

$$\begin{aligned} \text{Maximum A/C capacity of outdoor units} &= \text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio} \\ &\times \text{Rate of change of capacity due to piping length to the farthest indoor unit} \\ \text{When indoor units combination ratio exceeds 100\% :} & \\ \text{Maximum A/C capacity of outdoor units} &= \text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio} \\ &\times \text{Rate of change of capacity due to piping length to the farthest indoor unit} \end{aligned}$$

REYA168AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA168AATJA	φ 5/8
REYA168AAYDA	

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA168AATJA	φ 3/4
REYA168AAYDA	


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA168AATJA	φ 1/2
REYA168AAYDA	

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA168AATJA	0.4
REYA168AAYDA	

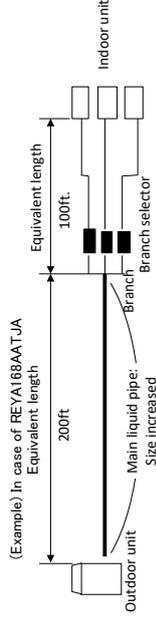

- 6. When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

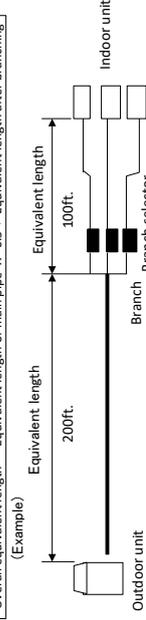

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 1.00.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	328	328	328	328	328	328	328	328	328	328	328	328	328	328	328	328
FL±	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197
Indoor Lower than Outdoor	295	295	295	295	295	295	295	295	295	295	295	295	295	295	295	295
Indoor Higher than Outdoor	262	262	262	262	262	262	262	262	262	262	262	262	262	262	262	262
FL±	230	230	230	230	230	230	230	230	230	230	230	230	230	230	230	230
Indoor Lower than Outdoor	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197
Indoor Higher than Outdoor	164	164	164	164	164	164	164	164	164	164	164	164	164	164	164	164
FL±	131	131	131	131	131	131	131	131	131	131	131	131	131	131	131	131
Indoor Lower than Outdoor	98	98	98	98	98	98	98	98	98	98	98	98	98	98	98	98
Indoor Higher than Outdoor	66	66	66	66	66	66	66	66	66	66	66	66	66	66	66	66
FL±	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	328	328	328	328	328	328	328	328	328	328	328	328	328	328	328	328
FL±	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197
Indoor Lower than Outdoor	295	295	295	295	295	295	295	295	295	295	295	295	295	295	295	295
Indoor Higher than Outdoor	262	262	262	262	262	262	262	262	262	262	262	262	262	262	262	262
FL±	230	230	230	230	230	230	230	230	230	230	230	230	230	230	230	230
Indoor Lower than Outdoor	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197	197
Indoor Higher than Outdoor	164	164	164	164	164	164	164	164	164	164	164	164	164	164	164	164
FL±	131	131	131	131	131	131	131	131	131	131	131	131	131	131	131	131
Indoor Lower than Outdoor	98	98	98	98	98	98	98	98	98	98	98	98	98	98	98	98
Indoor Higher than Outdoor	66	66	66	66	66	66	66	66	66	66	66	66	66	66	66	66
FL±	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity : The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{Rate of change of capacity due to piping length to the farthest outdoor unit}} \right] = \text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}$$

- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{Rate of change of capacity due to piping length to the farthest outdoor unit}} \right] = \text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}$$

REYA192AATJA / AAYDA

1. Rate of change of cooling capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
328	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
295	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
262	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
230	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
197	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
164	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
131	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
98	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
66	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
460	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
427	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
394	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
328	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
295	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
262	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
230	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
197	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
164	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
131	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
98	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
66	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid Pipe
REYA192AATJA REYA192AAYDA	φ 5/8

In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, >130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe, referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m), Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid Pipe
REYA192AATJA REYA192AAYDA	φ 3/4

[Diameter of pipe (Standard size)]

Model	Liquid Pipe
REYA192AATJA REYA192AAYDA	φ 1/2

5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA192AATJA REYA192AAYDA	0.4

2. Rate of change of heating capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
328	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
295	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
262	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
230	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
197	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
164	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
131	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
98	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
66	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Indoor Higher than Outdoor	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
460	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
427	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
394	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
361	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
328	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
295	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
262	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
230	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
197	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
164	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
131	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
98	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
66	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
0	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.


Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio exceeds 100% :


$$\text{Maximum A/C capacity of outdoor units} = \frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$$

6. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching



Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
 Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
 When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.



Overall equivalent length = 200ft. X 0.5 + Equivalent length after branching
 Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.96.

REYA216AATJA / AAYDA

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA216AATJA REYA216AAYDA	φ 5/8

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA216AATJA REYA216AAYDA	φ 3/4


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA216AATJA REYA216AAYDA	φ 1/2

- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA216AATJA REYA216AAYDA	0.4

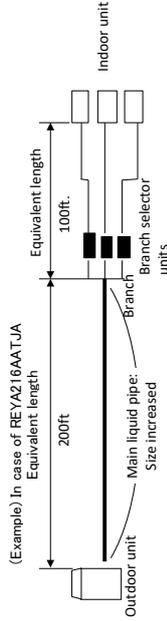

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

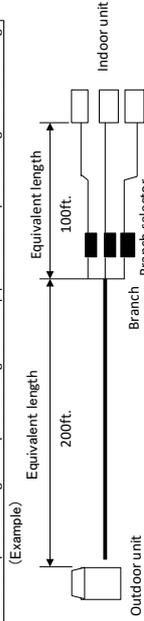

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.95.

1. Rate of change of cooling capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
361	-	-	-	-	-	-	-	-	-	-	0.86	0.85	0.84	0.83	0.82
328	-	-	-	-	-	-	-	-	-	-	0.88	0.87	0.85	0.84	0.83
295	-	-	-	-	-	-	-	-	-	0.89	0.88	0.87	0.86	0.85	0.84
262	-	-	-	-	-	-	-	-	0.91	0.89	0.88	0.87	0.86	0.85	0.84
230	-	-	-	-	-	-	-	0.92	0.91	0.89	0.88	0.87	0.86	0.85	0.84
197	-	-	-	-	-	0.94	0.92	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83
164	-	-	-	-	0.95	0.94	0.93	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83
131	-	-	-	0.98	0.96	0.95	0.93	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83
98	-	-	1.00	0.98	0.96	0.95	0.93	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83
66	-	1.00	1.00	0.98	0.97	0.95	0.93	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.83
FL±	0	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
Indoor Higher than Outdoor	0	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
25	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
55	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
85	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
115	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
145	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
175	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
205	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
235	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
265	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
295	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
325	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
355	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
385	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
415	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
445	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84
475	1.00	1.00	1.00	1.00	0.99	0.97	0.95	0.93	0.92	0.90	0.88	0.87	0.86	0.85	0.84

2. Rate of change of heating capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
361	-	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00
328	-	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00
295	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00
262	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00
230	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00
197	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
164	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
131	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
98	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
66	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
FL±	0	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Indoor Higher than Outdoor	0	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
25	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
55	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
85	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
115	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
145	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
175	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
205	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
235	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
265	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
295	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
325	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
355	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
385	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
415	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
445	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
475	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
- When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}} \right] =$$

When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}} \right] =$$

REYA240AATJA / AAYDA

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																			
	25	55	88	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656
Indoor Lower than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96
Indoor Higher than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96

4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA240AATJA REYA240AAYDA	φ 3/4

In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA240AATJA REYA240AAYDA	φ 7/8

[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA240AATJA REYA240AAYDA	φ 5/8

5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA240AATJA REYA240AAYDA	0.4

2. Rate of change of heating capacity


Vertical pipe length (ft.)	Equivalent Length (ft.)																			
	25	55	88	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656
Indoor Lower than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Indoor Higher than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

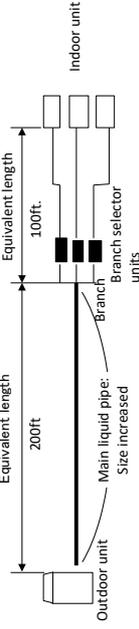

Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
 Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
 When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

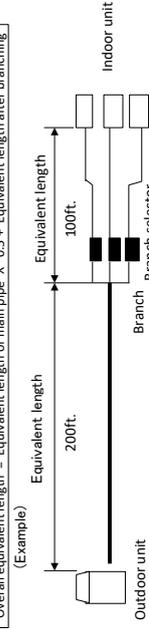

Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
 Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.96.

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
 The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

• When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

REYA264AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA264AATJA REYA264AAYDA	φ 3/4

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m), Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA264AATJA REYA264AAYDA	φ 7/8


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA264AATJA REYA264AAYDA	φ 5/8

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA264AATJA REYA264AAYDA	0.4

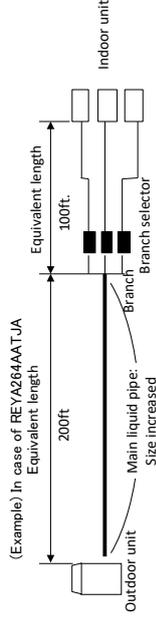

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
- Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

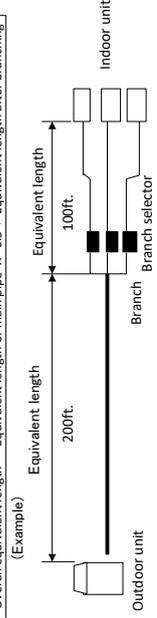

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 1.00.

1. Rate of change of cooling capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)																		
	25	56	88	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623
361	-	-	-	-	-	-	-	-	-	-	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
328	-	-	-	-	-	-	-	-	-	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
295	-	-	-	-	-	-	-	-	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
262	-	-	-	-	-	-	-	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
230	-	-	-	-	-	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85
197	-	-	-	-	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85
164	-	-	-	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85
131	-	-	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85
98	-	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
66	1.00	1.00	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87
25	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88
0	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88
25	1.00	1.00	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87
66	1.00	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86
98	1.00	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85
131	1.00	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84
164	1.00	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83
197	1.00	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82
230	0.99	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81
262	0.98	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81	0.80
295	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81	0.80	0.79
328	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81	0.80	0.79	0.78
361	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81	0.80	0.79	0.78	0.77

2. Rate of change of heating capacity

Indoor Lower than Outdoor	Equivalent Length (ft.)														
	25	56	88	131	164	197	230	262	295	328	361	394	427	460	
361	-	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	
328	-	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	
295	-	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	
262	-	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
230	-	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
197	-	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
164	-	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
131	-	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
98	-	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
66	-	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
25	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
0	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
25	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
66	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
98	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
131	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
164	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
197	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
230	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
262	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
295	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
328	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	
361	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio exceeds 100% : $\text{Maximum A/C capacity of outdoor units} \times \text{Rate of change of capacity due to piping length to the farthest indoor unit}$

Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio does not exceed 100% : $\text{Maximum A/C capacity of outdoor units} \times \text{Rate of change of capacity due to piping length to the farthest indoor unit}$

REYA288AATJA / AAYDA

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
	25	56	98	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656	689	722	755	788	821	854	887	920	953	986	1019	1052	1085	1118	1151	1184	1217	1250	1283	1316	1349	1382	1415	1448	1481	1514	1547	1580	1613	1646	1679	1712	1745	1778	1811	1844	1877	1910	1943	1976	2009	2042	2075	2108	2141	2174	2207	2240	2273	2306	2339	2372	2405	2438	2471	2504	2537	2570	2603	2636	2669	2702	2735	2768	2801	2834	2867	2900	2933	2966	2999	3032	3065	3098	3131	3164	3197	3230	3263	3296	3329	3362	3395	3428	3461	3494	3527	3560	3593	3626	3659	3692	3725	3758	3791	3824	3857	3890	3923	3956	3989	4022	4055	4088	4121	4154	4187	4220	4253	4286	4319	4352	4385	4418	4451	4484	4517	4550	4583	4616	4649	4682	4715	4748	4781	4814	4847	4880	4913	4946	4979	5012	5045	5078	5111	5144	5177	5210	5243	5276	5309	5342	5375	5408	5441	5474	5507	5540	5573	5606	5639	5672	5705	5738	5771	5804	5837	5870	5903	5936	5969	6002	6035	6068	6101	6134	6167	6200	6233	6266	6299	6332	6365	6398	6431	6464	6497	6530	6563	6596	6629	6662	6695	6728	6761	6794	6827	6860	6893	6926	6959	6992	7025	7058	7091	7124	7157	7190	7223	7256	7289	7322	7355	7388	7421	7454	7487	7520	7553	7586	7619	7652	7685	7718	7751	7784	7817	7850	7883	7916	7949	7982	8015	8048	8081	8114	8147	8180	8213	8246	8279	8312	8345	8378	8411	8444	8477	8510	8543	8576	8609	8642	8675	8708	8741	8774	8807	8840	8873	8906	8939	8972	9005	9038	9071	9104	9137	9170	9203	9236	9269	9302	9335	9368	9401	9434	9467	9500	9533	9566	9599	9632	9665	9698	9731	9764	9797	9830	9863	9896	9929	9962	9995	10028	10061	10094	10127	10160	10193	10226	10259	10292	10325	10358	10391	10424	10457	10490	10523	10556	10589	10622	10655	10688	10721	10754	10787	10820	10853	10886	10919	10952	10985	11018	11051	11084	11117	11150	11183	11216	11249	11282	11315	11348	11381	11414	11447	11480	11513	11546	11579	11612	11645	11678	11711	11744	11777	11810	11843	11876	11909	11942	11975	12008	12041	12074	12107	12140	12173	12206	12239	12272	12305	12338	12371	12404	12437	12470	12503	12536	12569	12602	12635	12668	12701	12734	12767	12800	12833	12866	12899	12932	12965	12998	13031	13064	13097	13130	13163	13196	13229	13262	13295	13328	13361	13394	13427	13460	13493	13526	13559	13592	13625	13658	13691	13724	13757	13790	13823	13856	13889	13922	13955	13988	14021	14054	14087	14120	14153	14186	14219	14252	14285	14318	14351	14384	14417	14450	14483	14516	14549	14582	14615	14648	14681	14714	14747	14780	14813	14846	14879	14912	14945	14978	15011	15044	15077	15110	15143	15176	15209	15242	15275	15308	15341	15374	15407	15440	15473	15506	15539	15572	15605	15638	15671	15704	15737	15770	15803	15836	15869	15902	15935	15968	16001	16034	16067	16100	16133	16166	16199	16232	16265	16298	16331	16364	16397	16430	16463	16496	16529	16562	16595	16628	16661	16694	16727	16760	16793	16826	16859	16892	16925	16958	16991	17024	17057	17090	17123	17156	17189	17222	17255	17288	17321	17354	17387	17420	17453	17486	17519	17552	17585	17618	17651	17684	17717	17750	17783	17816	17849	17882	17915	17948	17981	18014	18047	18080	18113	18146	18179	18212	18245	18278	18311	18344	18377	18410	18443	18476	18509	18542	18575	18608	18641	18674	18707	18740	18773	18806	18839	18872	18905	18938	18971	19004	19037	19070	19103	19136	19169	19202	19235	19268	19301	19334	19367	19400	19433	19466	19499	19532	19565	19598	19631	19664	19697	19730	19763	19796	19829	19862	19895	19928	19961	19994	20027	20060	20093	20126	20159	20192	20225	20258	20291	20324	20357	20390	20423	20456	20489	20522	20555	20588	20621	20654	20687	20720	20753	20786	20819	20852	20885	20918	20951	20984	21017	21050	21083	21116	21149	21182	21215	21248	21281	21314	21347	21380	21413	21446	21479	21512	21545	21578	21611	21644	21677	21710	21743	21776	21809	21842	21875	21908	21941	21974	22007	22040	22073	22106	22139	22172	22205	22238	22271	22304	22337	22370	22403	22436	22469	22502	22535	22568	22601	22634	22667	22700	22733	22766	22799	22832	22865	22898	22931	22964	22997	23030	23063	23096	23129	23162	23195	23228	23261	23294	23327	23360	23393	23426	23459	23492	23525	23558	23591	23624	23657	23690	23723	23756	23789	23822	23855	23888	23921	23954	23987	24020	24053	24086	24119	24152	24185	24218	24251	24284	24317	24350	24383	24416	24449	24482	24515	24548	24581	24614	24647	24680	24713	24746	24779	24812	24845	24878	24911	24944	24977	25010	25043	25076	25109	25142	25175	25208	25241	25274	25307	25340	25373	25406	25439	25472	25505	25538	25571	25604	25637	25670	25703	25736	25769	25802	25835	25868	25901	25934	25967	26000	26033	26066	26099	26132	26165	26198	26231	26264	26297	26330	26363	26396	26429	26462	26495	26528	26561	26594	26627	26660	26693	26726	26759	26792	26825	26858	26891	26924	26957	26990	27023	27056	27089	27122	27155	27188	27221	27254	27287	27320	27353	27386	27419	27452	27485	27518	27551	27584	27617	27650	27683	27716	27749	27782	27815	27848	27881	27914	27947	27980	28013	28046	28079	28112	28145	28178	28211	28244	28277	28310	28343	28376	28409	28442	28475	28508	28541	28574	28607	28640	28673	28706	28739	28772	28805	28838	28871	28904	28937	28970	29003	29036	29069	29102	29135	29168	29201	29234	29267	29300	29333	29366	29399	29432	29465	29498	29531	29564	29597	29630	29663	29696	29729	29762	29795	29828	29861	29894	29927	29960	29993	30026	30059	30092	30125	30158	30191	30224	30257	30290	30323	30356	30389	30422	30455	30488	30521	30554	30587	30620	30653	30686	30719	30752	30785	30818	30851	30884	30917	30950	30983	31016	31049	31082	31115	31148	31181	31214	31247	31280	31313	31346	31379	31412	31445	31478	31511	31544	31577	31610	31643	31676	31709	31742	31775	31808	31841	31874	31907	31940	31973	32006	32039	32072	32105	32138	32171	32204	32237	32270	32303	32336	32369	32402	32435	32468	32501	32534	32567	32600	32633	32666	32699	32732	32765	32798	32831	32864	32897	32930	32963	32996	33029	33062	33095	33128	33161	33194	33227	33260	33293	33326	33359	33392	33425	33458	33491	33524	33557	33590	33623	33656	33689	33722	33755	33788	33821	33854	33887	33920	33953	33986	34019	34052	34085	34118	34151	34184	34217	34250	34283	34316	34349	34382	34415	34448	34481	34514	34547	34580	34613	34646	34679	34712	34745	34778	34811	34844	34877	34910	34943	34976	35009	35042	35075	35108	35141	35174	35207	35240	35273	35306	35339	35372	35405	35438	35471	35504	35537	35570	35603	35636	35669	35702	35735	35768	35801	35834	35867	35900	35933	35966	36000	36033	36066	36099	36132	36165	36198	36231	36264	36297	36330	36363	36396	36429	36462	36495	36528	36561	36594	36627	36660	36693	36726	36759	36792	36825	36858	36891	36924	36957	36990	37023	37056	37089	37122	37155	37188	37221	37254	37287	37320	37353	37386	37419	37452	37485	37518	37551	37584	37617	37650	37683	37716	37749	37782	37815	37848	37881	37914	37947	37980	38013	38046	38079	38112	38145	38178	38211	38244	38277	38310	38343	38376	38409	38442	38475	38508	38541	38574	38607	38640	38673	38706	38739	38772	38805	38838	38871	38904	38937	38970	39003	39036	39069	39102	39135	39168	39201	39234	39267	39300	39333	39366	39399	39432	39465	39498	39531	39564	39597	39630	39663	39696	39729	39762	39795	39828	39861	39894	39927	39960	39993	40026	40059	40092	40125	40158	40191	40224	40257	40290	40323	40356	40389	40422	40455	40488	40521	40554	40587	40620	40653	40686	40719	40752	40785	40818	40851	40884	40917	40950	40983	41016	41049

REYA312AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA312AATJA REYA312AAYDA	φ 3/4

- In the case where the equivalent piping length from outdoor units to indoor units ≥ 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).


Model	Liquid pipe
REYA312AATJA REYA312AAYDA	φ 7/8

[Diameter of pipe (Standard size)]


Model	Liquid pipe
REYA312AATJA REYA312AAYDA	φ 5/8

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Model	Correction factor
REYA312AATJA REYA312AAYDA	0.4

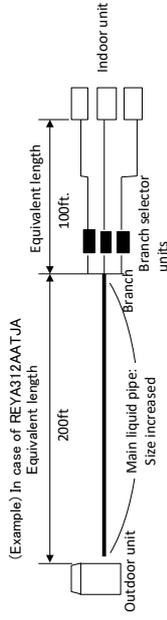

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
 Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
 When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

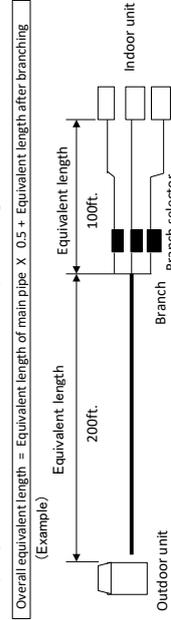

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
 Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.97.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																			
	25	56	88	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656
Indoor Lower than Outdoor	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99
Indoor Higher than Outdoor	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)																			
	25	56	88	131	164	197	230	262	295	328	361	394	427	460	493	526	559	592	623	656
Indoor Lower than Outdoor	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99
Indoor Higher than Outdoor	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99	0.99

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- With this outdoor unit, evaporating pressure becomes smaller than that of indoor units obtained from capacity control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
 The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

- When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of indoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$
- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of indoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

REYA336AATJA / AAYDA

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA336AATJA REYA336AAYDA	φ 3/4

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m), Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA336AATJA REYA336AAYDA	φ 7/8


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA336AATJA REYA336AAYDA	φ 5/8

- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA336AATJA REYA336AAYDA	0.4

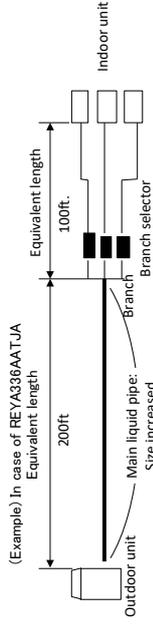

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

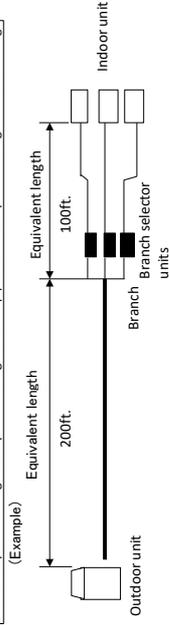

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.96.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
Indoor Lower than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96
Indoor Higher than Outdoor	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96	0.96

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
Indoor Lower than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
Indoor Higher than Outdoor	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than this.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
- When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times$$

- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times$$

REYA360AATJA / AAYDA

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA360AATJA REYA360AAYDA	φ 3/4

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m), Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA360AATJA REYA360AAYDA	φ 7/8


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA360AATJA REYA360AAYDA	φ 5/8

- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA360AATJA REYA360AAYDA	0.4

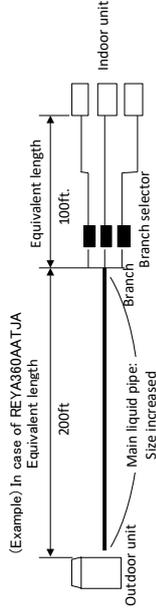

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
- Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

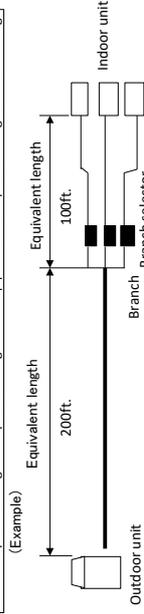

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.98.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98
Indoor Higher than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98
Indoor Higher than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio exceeds 100% : $\text{Maximum A/C capacity of outdoor units} \times \text{Rate of change of capacity due to piping length to the farthest indoor unit}$

Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio does not exceed 100% : $\text{Maximum A/C capacity of outdoor units} \times \text{Rate of change of capacity due to piping length to the farthest indoor unit}$

REYA384AATJA / AAYDA

- When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA384AATJA REYA384AAYDA	φ 3/4

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).


Model	Liquid pipe
REYA384AATJA REYA384AAYDA	φ 7/8

[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA384AATJA REYA384AAYDA	φ 5/8


- When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Model	Correction factor
REYA384AATJA REYA384AAYDA	0.4

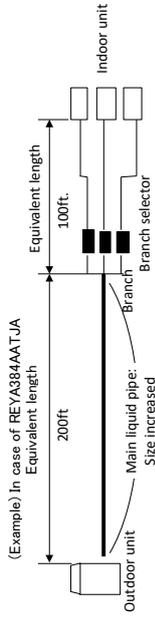

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

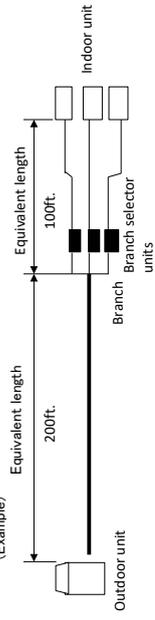

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.98.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98
Indoor Higher than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98
Indoor Higher than Outdoor	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98	0.98

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio exceeds 100% :
Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

When indoor units combination ratio does not exceed 100% :
Maximum A/C capacity of outdoor units = $\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}$

REYA408AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA408AATJA REYA408AAYDA	φ 7/8

- In the case where the equivalent piping length from outdoor units to indoor units ≥ 295 ft. (90 m) and Height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).


Model	Liquid pipe
REYA408AATJA REYA408AAYDA	Not increased

[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA408AATJA REYA408AAYDA	φ 3/4


- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Model	Correction factor
REYA408AATJA REYA408AAYDA	0.4

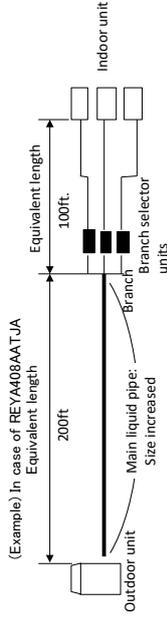

- Overall equivalent length = 200ft. X 0.4 + 100 ft. = 180 ft.
- Thus rate of change of heating capacity when "Vertical pipe length" = 0ft. is approximately 1.00.
- When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

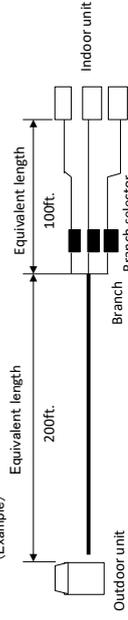

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 1.00.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93
FL±	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93
Indoor Higher than Outdoor	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93
FL±	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93
Indoor Higher than Outdoor	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93	0.93

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than them.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity :
The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.

When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of indoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of indoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

REYA432AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit – branch sections) must be increased to below size

Model	Liquid pipe
REYA432AATJA REYA432AAYDA	φ 7/8

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).


Model	Liquid pipe
REYA432AATJA REYA432AAYDA	Not increased

[Diameter of pipe (Standard size)]


Model	Liquid pipe
REYA432AATJA REYA432AAYDA	φ 3/4

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.

Model	Correction factor
REYA432AATJA REYA432AAYDA	0.4

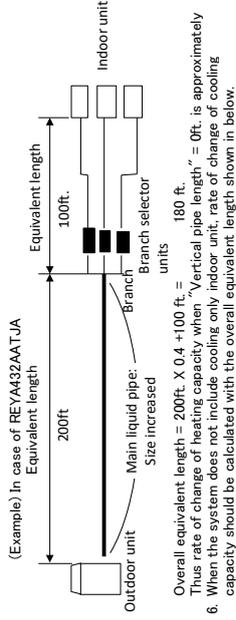

- 6. When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

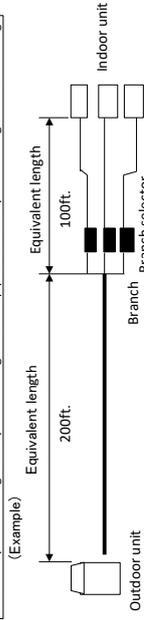

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94
Indoor Higher than Outdoor	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94
Indoor Higher than Outdoor	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- With this outdoor unit, evaporating pressure becomes constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity : The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right]$$

REYA456AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA456AATJA REYA456AAYDA	φ 7/8

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA456AATJA REYA456AAYDA	Not increased


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA456AATJA REYA456AAYDA	φ 3/4

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA456AATJA REYA456AAYDA	0.4

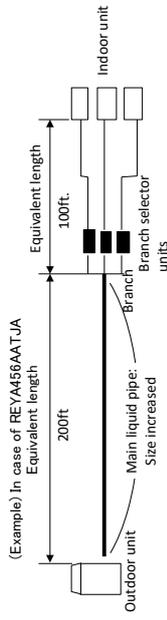

- 6. When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

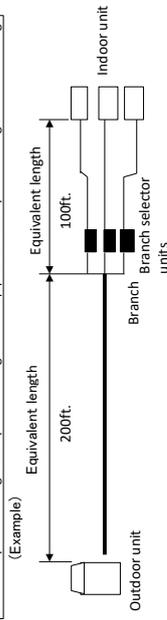

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.95.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83
Indoor Higher than Outdoor	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83	0.83

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)															
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445	475
Indoor Lower than Outdoor	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77
Indoor Higher than Outdoor	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77	0.77

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than this.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100\% indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times$$

- When indoor units combination ratio exceeds 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] = \left[\frac{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}}{\text{Rate of change of capacity due to piping length to the farthest indoor unit}} \right] \times$$

REYA480AATJA / AAYDA

- 4. When overall equivalent pipe length is 295ft. or more, the diameter of the main liquid pipes (outdoor unit - branch sections) must be increased to below size

Model	Liquid pipe
REYA480AATJA REYA480AAYDA	φ 7/8

- In the case where the equivalent piping length from outdoor units to indoor units is 295 ft. (90 m) and height difference between outdoor unit and indoor unit (H1) > 164 ft. (50 m) (if outdoor unit is lower than indoor unit, > 130 ft. (40 m)), make sure to two size up the liquid pipe of the main pipe referring to the table below. (In this case, the main pipe length should be less than 246 ft. (75 m). Height difference between outdoor unit and indoor unit (H1) should be less than 361 ft. (110 m).

Model	Liquid pipe
REYA480AATJA REYA480AAYDA	Not increased


[Diameter of pipe (Standard size)]

Model	Liquid pipe
REYA480AATJA REYA480AAYDA	φ 3/4

- 5. When the diameter of the main liquid pipe is increased, rate of change of heating capacity should be calculated with the overall equivalent length shown in below.


Overall equivalent length = Equivalent length of main pipe X Correction factor + Equivalent length after branching

Model	Correction factor
REYA480AATJA REYA480AAYDA	0.4

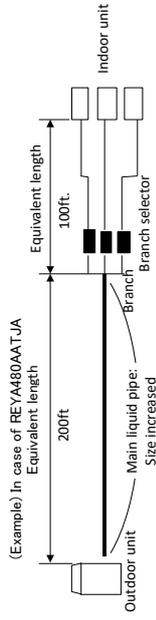

- 6. When the system does not include cooling only indoor unit, rate of change of cooling capacity should be calculated with the overall equivalent length shown in below.

Overall equivalent length = Equivalent length of main pipe X 0.5 + Equivalent length after branching

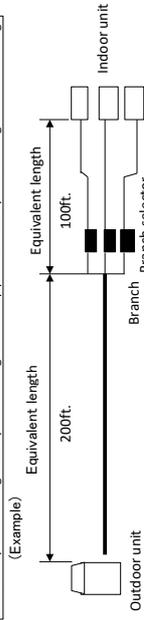

- Overall equivalent length = 200ft. X 0.5 + 100 ft. = 200 ft.
- Thus rate of change of cooling capacity when "Vertical pipe length" = 0ft. is approximately 0.95.

1. Rate of change of cooling capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
Indoor Lower than Outdoor	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81
Indoor Higher than Outdoor	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82
FL±	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81

2. Rate of change of heating capacity

Vertical pipe length (ft.)	Equivalent Length (ft.)														
	25	55	85	115	145	175	205	235	265	295	325	355	385	415	445
Indoor Lower than Outdoor	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81
Indoor Higher than Outdoor	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82
FL±	0.95	0.94	0.93	0.92	0.91	0.90	0.89	0.88	0.87	0.86	0.85	0.84	0.83	0.82	0.81

[Notes]

- Above figures indicate the rate of change of capacity when a standard system (indoor units combination ratio is 100%) is operated at maximum load (with the thermostat set to maximum) under standard conditions.
- Under partial load conditions, capacity change becomes smaller than this.
- With this outdoor unit, evaporating pressure constant control when cooling and condensing pressure constant control when heating are carried out.
- Method of calculating A/C (cooling/heating) capacity : The maximum A/C capacity of the system is the smaller of the total A/C capacity of the indoor units obtained from capacity characteristic table or the maximum A/C capacity of outdoor units calculated in below.
 - When indoor units combination ratio does not exceed 100% :

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at 100% indoor units combination ratio}} \right]$$

$$\left[\frac{\text{Maximum A/C capacity of outdoor units}}{\text{Maximum A/C capacity of indoor units}} \right] \times \left[\frac{\text{Rate of change of capacity due to piping length to the farthest indoor unit}}{\text{A/C capacity of outdoor units obtained from capacity characteristic table at that indoor units combination ratio}} \right]$$

1.4 Notes for Heating Capacity Characteristics (Heat Recovery)

REYA72 - 480AATJA / AAYDA

- The capacity tables do not account for the reduction in capacity during frost accumulation or operation in defrost mode. Heating capacity which takes the above mentioned factors into consideration can be calculated as follows;

Formula

Heating capacity = A × B × C

A: Capacity value given in the capacity tables

B: Correction factor for frost accumulation

C: Correction factor for connection ratio


- Correction factor for frost accumulation (B)

Inlet air temperature to the outdoor unit heat exchanger (°FDB/RH85%)		19.5	23.0	26.5	32.0	37.5	41.0	44.5
Correction factor for frost accumulation	REYA72AATJA/AAYDA	0.97	0.95	0.90	0.86	0.87	0.92	1.00
	REYA96AATJA/AAYDA	0.97	0.95	0.90	0.86	0.87	0.92	1.00
	REYA120AATJA/AAYDA	0.97	0.95	0.90	0.86	0.87	0.92	1.00
	REYA144AATJA/AAYDA	0.97	0.95	0.90	0.86	0.87	0.92	1.00
	REYA168AATJA/AAYDA	0.96	0.94	0.89	0.85	0.86	0.91	1.00
	REYA192AATJA/AAYDA	0.95	0.92	0.86	0.81	0.82	0.90	1.00
	REYA216AATJA/AAYDA	0.95	0.92	0.85	0.80	0.82	0.90	1.00
	REYA240AATJA/AAYDA	0.95	0.92	0.85	0.79	0.81	0.89	1.00
	REYA264AATJA/AAYDA	0.99	0.97	0.92	0.88	0.89	0.94	1.00
	REYA288AATJA/AAYDA	0.99	0.97	0.92	0.88	0.89	0.94	1.00
	REYA312AATJA/AAYDA	0.99	0.97	0.92	0.88	0.89	0.94	1.00
	REYA336AATJA/AAYDA	0.96	0.94	0.89	0.85	0.89	0.94	1.00
	REYA360AATJA/AAYDA	0.95	0.93	0.87	0.83	0.84	0.91	1.00
	REYA384AATJA/AAYDA	0.95	0.92	0.86	0.81	0.82	0.90	1.00
	REYA408AATJA/AAYDA	0.95	0.92	0.86	0.80	0.82	0.90	1.00
	REYA432AATJA/AAYDA	0.95	0.92	0.85	0.80	0.82	0.90	1.00
REYA456AATJA/AAYDA	0.95	0.92	0.85	0.79	0.81	0.90	1.00	
REYA480AATJA/AAYDA	0.95	0.92	0.85	0.79	0.81	0.89	1.00	

- Correction factor for connection ratio (C)

Connection ratio	≤130%	≤140%	≤150%	≤160%	≤170%	≤180%	≤190%	≤200%
Correction factor for connection ratio	1.0	0.99	0.98	0.97	0.95	0.94	0.93	0.92

Note: Correction factor for frost accumulation calculated from integrated heating capacity while 1 cycle (between 2 defrosting operations) as shown in below figure.

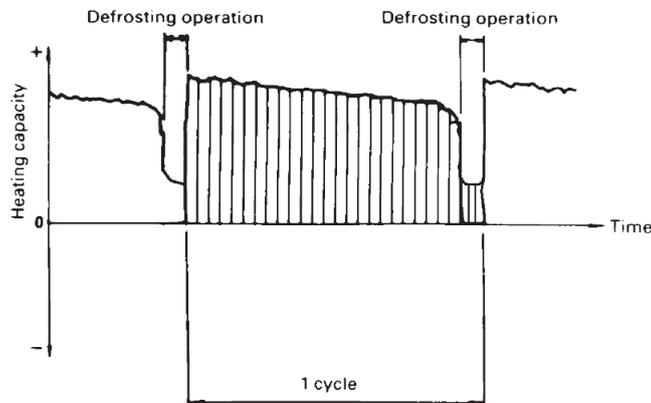

- Accumulation of frost / snow on the outdoor unit heat exchanger leads to a temporary reduction in capacity. The degree of capacity reduction depends on factors such as outdoor temperature (DB), relative humidity (RH), amount of frost, etc.

Warning



- Ask a qualified installer or contractor to install this product. Do not try to install the product yourself. Improper installation can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Use only those parts and accessories supplied or specified by Daikin. Ask a qualified installer or contractor to install those parts and accessories. Use of unauthorised parts and accessories or improper installation of parts and accessories can result in water or refrigerant leakage, electrical shock, fire or explosion.
- Read the user's manual carefully before using this product. The user's manual provides important safety instructions and warnings. Be sure to follow these instructions and warnings.

If you have any inquiries, please contact your local importer, distributor and/or retailer.

Cautions on product corrosion

1. Air conditioners should not be installed in areas where corrosive gases, such as acid gas or alkaline gas, are produced.
2. If the outdoor unit is to be installed close to the sea shore, direct exposure to the sea breeze should be avoided. If you need to install the outdoor unit close to the sea shore, contact your local distributor.